


Description of options

Option M15 Conf. I/O ext. card – 4 analogue inputs Multi-line 2 – version 2

4189340285C
SW version 2.4X.X

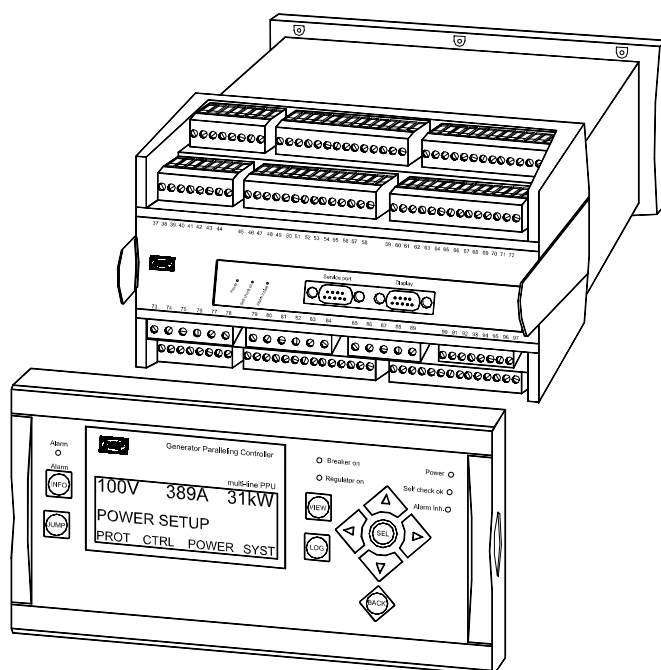

- *Description of option*
- *Functional description*
- *Parameter list*

CE

Table of contents

| | |
|---|----------|
| 1. WARNINGS AND LEGAL INFORMATION..... | 3 |
| ELECTROSTATIC DISCHARGE AWARENESS | 3 |
| SAFETY ISSUES..... | 3 |
| DEFINITIONS | 3 |
| 2. DESCRIPTION OF OPTION | 4 |
| M15 OPTION | 4 |
| TERMINAL DESCRIPTION | 4 |
| 3. FUNCTIONAL DESCRIPTION..... | 5 |
| PC UTILITY SOFTWARE CONFIGURATION..... | 5 |
| DISPLAY READINGS | 7 |
| 4. PARAMETER LIST | 8 |

This manual is valid for standard multi-line 2 PPU/GPU/GPC units with firmware version 2.00.0 or later.

1. Warnings and legal information

DEIF takes no responsibility for installation or operation of the generator set. If there is any doubt about how to install or operate the generator set controlled by the unit, the company responsible for the installation or the operation of the set must be contacted.

The units are not to be opened by unauthorised personnel. If opened anyway, the warranty will be lost.

Electrostatic discharge awareness

Sufficient care must be taken to protect the terminals against static discharges during the installation. Once the unit is installed and connected, these precautions are no longer necessary.

Safety issues

Installing the unit implies work with dangerous currents and voltages. Therefore, the installation should only be carried out by authorised personnel who understand the risks involved in working with live electrical equipment.



Be aware of the hazardous live currents and voltages. Do not touch any AC measurement inputs as this could lead to injury or death.

Definitions

Throughout this document a number of notes and warnings will be presented. To ensure that these are noticed, they will be highlighted in order to separate them from the general text.

Notes



The notes provide general information which will be helpful for the reader to bear in mind.

Warning



The warnings indicate a potentially dangerous situation which could result in death, personal injury or damaged equipment, if certain guidelines are not followed.

2. Description of option

M15 option

| Function | ANSI no. |
|----------------------------------|----------|
| 4 x configurable 4...20mA inputs | - |

Terminal description

| Term. | Function | Technical data | Description |
|-------|--------------------|----------------|------------------------------|
| 126 | Analogue input 5 - | Common | 4...20mA input, configurable |
| 127 | Analogue input 5 + | 4...20mA in | |
| 128 | Analogue input 6 - | Common | 4...20mA input, configurable |
| 129 | Analogue input 6 + | 4...20mA in | |
| 130 | Analogue input 7 - | Common | 4...20mA input, configurable |
| 131 | Analogue input 7 + | 4...20mA in | |
| 132 | Analogue input 8 - | Common | 4...20mA input, configurable |
| 133 | Analogue input 8 + | 4...20mA in | |



Please refer to the Application Notes for the connection of active and passive sensors.

3. Functional description

PC utility software configuration

The PC utility software is a Windows® based software, which can be downloaded from our website www.deif.com. To adjust the inputs via the PC utility software, a computer must be connected to the controller unit. Furthermore, the unit parameters must be uploaded to the computer.


Alarm input configuration

The alarm input is configured by selecting the correct input in the parameter file (in this example analogue input 5.1):

The screenshot shows a configuration window titled "Parameter '5.1 4-20mA' (Channel 3520)". It contains several sections:

- Setpoint:** Unit: None, value: 10. Range: 4 to 20.
- Timer:** 10 sec. Range: 0,2 to 100,0.
- Output A:** Output 2.
- Output B:** Output 0.
- Commissioning:** Actual value: 1, Time elapsed: 0 sec (0%). Range: 0 sec to 10 sec.
- Options:**
 - Enable
 - High Alarm
 - Inverse proportional
 - Cable supervision
- Buttons:** Write, OK, Cancel.

Set point

The set point can be adjusted by moving the glider left or right or by clicking the present set point. (Above click '10'). The text can be configured by clicking the button  left of the existing text. The unit can be selected to relevant values, e.g. volt, amp, RPM etc.



The unit can only be selected in the menus 3520, 3540, 3560 and 3580.

Timer

The timer can be adjusted by moving the glider left or right or by clicking the present set point. (Above click '10 sec').

Output A/output B

Select which relay to activate in connection with an alarm.

Enable

Mark this check box to enable the alarm function.


High alarm

Mark this check box to receive an alarm when the input is above the set point. Unmark this check box to receive an alarm when the input is below the set point.

Inverse proportional

In situations where the signal of the input is reversed, the 'Inverse proportional' selection can be made. The selection makes sure that the display reading will be correct when an 'inversed' signal is made.

The diagram shows the characteristics of the 'normal' proportional sensor and of the inversed proportional sensor.

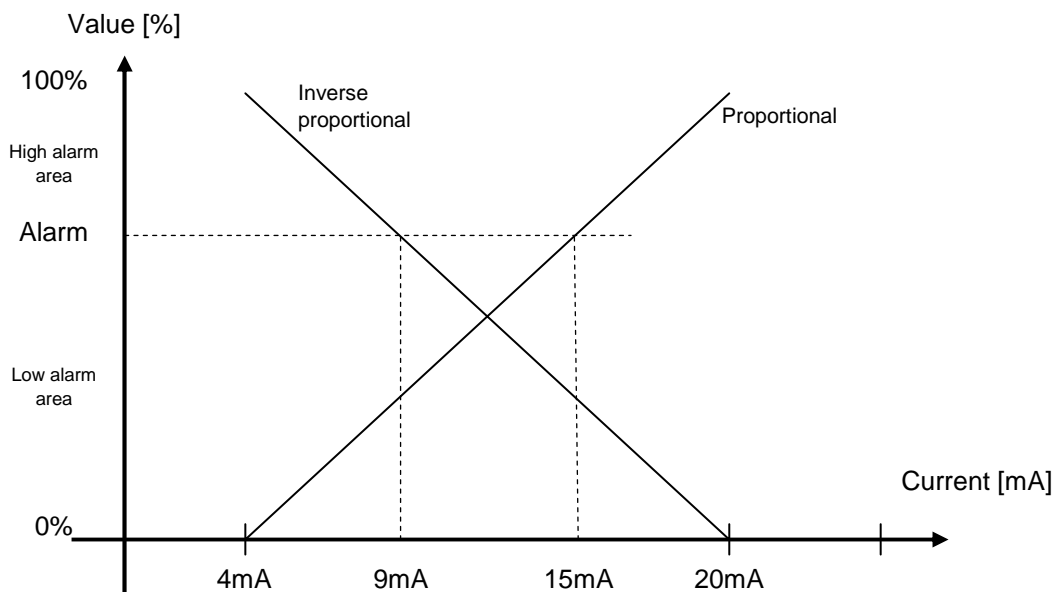

Display readings

In the display, the readings of the 4-20mA input can be read. It can be found in setup menu system in the second line or, if configured, in the view menu system.

Setup menu

```
G 400 400 400V
5.1 4-20mA 15mA
PROTECTION SETUP
PROT CTRL INPUT SYST
```

View menu

```
B-L1 50.0Hz 400V
G-L1 50.0Hz 400V
5.1 4-20mA 15mA
SETUP V3 V2 V1
```



Refer to the Designer's Reference Handbook regarding configuration of the display views.



If the text of the input is changed, you will see the changed text. This could e.g. be 'Oil press. ##bar' instead of '5.1 4-20mA ##mA'

4. Parameter list



For further information about the structure of the parameter descriptions, please see the Designer's Reference Handbook.

3520 4...20mA input 5.1

Input 5 is used by option O1, 'water turbine control' for water level input.



If option O is not present, the input can be used as a normal configurable analogue input.

| No. | Setting | | Min. setting | Max. setting | Factory setting |
|------|--------------------|----------------|--------------|------------------|-----------------|
| 3521 | 4...20mA input 5.1 | Set point | 0mA | 20mA | 10mA |
| 3522 | 4...20mA input 5.1 | Timer | 0.2 s | 100.0 s | 10.0 s |
| 3523 | 4...20mA input 5.1 | Relay output A | R0 (none) | Option dependent | R2 (relay 2) |
| 3524 | 4...20mA input 5.1 | Relay output B | R0 (none) | | R0 (none) |
| 3525 | 4...20mA input 5.1 | Enable | OFF | ON | OFF |

3530 4...20mA input 5.2

Input 5 is used by option O1, 'water turbine control' for water level input.



If option O is not present, the input can be used as a normal configurable analogue input.

| No. | Setting | | Min. setting | Max. setting | Factory setting |
|------|--------------------|----------------|--------------|------------------|-----------------|
| 3531 | 4...20mA input 5.2 | Set point | 0mA | 20mA | 10mA |
| 3532 | 4...20mA input 5.2 | Timer | 0.2 s | 100.0 s | 10.0 s |
| 3533 | 4...20mA input 5.2 | Relay output A | R0 (none) | Option dependent | R2 (relay 2) |
| 3534 | 4...20mA input 5.2 | Relay output B | R0 (none) | | R0 (none) |
| 3535 | 4...20mA input 5.2 | Enable | OFF | ON | OFF |

3540 4...20mA input 6.1

| No. | Setting | | Min. setting | Max. setting | Factory setting |
|------|--------------------|----------------|--------------|------------------|-----------------|
| 3541 | 4...20mA input 6.1 | Set point | 0mA | 20mA | 10mA |
| 3542 | 4...20mA input 6.1 | Timer | 0.2 s | 100.0 s | 10.0 s |
| 3543 | 4...20mA input 6.1 | Relay output A | R0 (none) | Option dependent | R2 (relay 2) |
| 3544 | 4...20mA input 6.1 | Relay output B | R0 (none) | | R0 (none) |
| 3545 | 4...20mA input 6.1 | Enable | OFF | ON | OFF |

3550 4...20mA input 6.2

| No. | Setting | | Min. setting | Max. setting | Factory setting |
|------|--------------------|----------------|--------------|------------------|-----------------|
| 3551 | 4...20mA input 6.2 | Set point | 0mA | 20mA | 10mA |
| 3552 | 4...20mA input 6.2 | Timer | 0.2 s | 100.0 s | 10.0 s |
| 3553 | 4...20mA input 6.2 | Relay output A | R0 (none) | Option dependent | R2 (relay 2) |
| 3554 | 4...20mA input 6.2 | Relay output B | R0 (none) | | R0 (none) |
| 3555 | 4...20mA input 6.2 | Enable | OFF | ON | OFF |

3560 4...20mA input 7.1

| No. | Setting | | Min. setting | Max. setting | Factory setting |
|------|--------------------|----------------|--------------|------------------|-----------------|
| 3561 | 4...20mA input 7.1 | Set point | 0mA | 20mA | 10mA |
| 3562 | 4...20mA input 7.1 | Timer | 0.2 s | 100.0 s | 10.0 s |
| 3563 | 4...20mA input 7.1 | Relay output A | R0 (none) | Option dependent | R2 (relay 2) |
| 3564 | 4...20mA input 7.1 | Relay output B | R0 (none) | | R0 (none) |
| 3565 | 4...20mA input 7.1 | Enable | OFF | ON | OFF |

3570 4...20mA input 7.2

| No. | Setting | | Min. setting | Max. setting | Factory setting |
|------|--------------------|----------------|--------------|------------------|-----------------|
| 3571 | 4...20mA input 7.2 | Set point | 0mA | 20mA | 10mA |
| 3572 | 4...20mA input 7.2 | Timer | 0.2 s | 100.0 s | 10.0 s |
| 3573 | 4...20mA input 7.2 | Relay output A | R0 (none) | Option dependent | R2 (relay 2) |
| 3574 | 4...20mA input 7.2 | Relay output B | R0 (none) | | R0 (none) |
| 3575 | 4...20mA input 7.2 | Enable | OFF | ON | OFF |

3580 4...20mA input 8.1

| No. | Setting | | Min. setting | Max. setting | Factory setting |
|------|--------------------|----------------|--------------|------------------|-----------------|
| 3581 | 4...20mA input 8.1 | Set point | 0mA | 20mA | 10mA |
| 3582 | 4...20mA input 8.1 | Timer | 0.2 s | 100.0 s | 10.0 s |
| 3583 | 4...20mA input 8.1 | Relay output A | R0 (none) | Option dependent | R2 (relay 2) |
| 3584 | 4...20mA input 8.1 | Relay output B | R0 (none) | | R0 (none) |
| 3585 | 4...20mA input 8.1 | Enable | OFF | ON | OFF |

3590 4...20mA input 8.2

| No. | Setting | | Min. setting | Max. setting | Factory setting |
|------|--------------------|----------------|--------------|------------------|-----------------|
| 3591 | 4...20mA input 8.2 | Set point | 0mA | 20mA | 10mA |
| 3592 | 4...20mA input 8.2 | Timer | 0.2 s | 100.0 s | 10.0 s |
| 3593 | 4...20mA input 8.2 | Relay output A | R0 (none) | Option dependent | R2 (relay 2) |
| 3594 | 4...20mA input 8.2 | Relay output B | R0 (none) | | R0 (none) |
| 3595 | 4...20mA input 8.2 | Enable | OFF | ON | OFF |

DEIF A/S reserves the right to change any of the above